


# Forced Convection Method Pressurizing

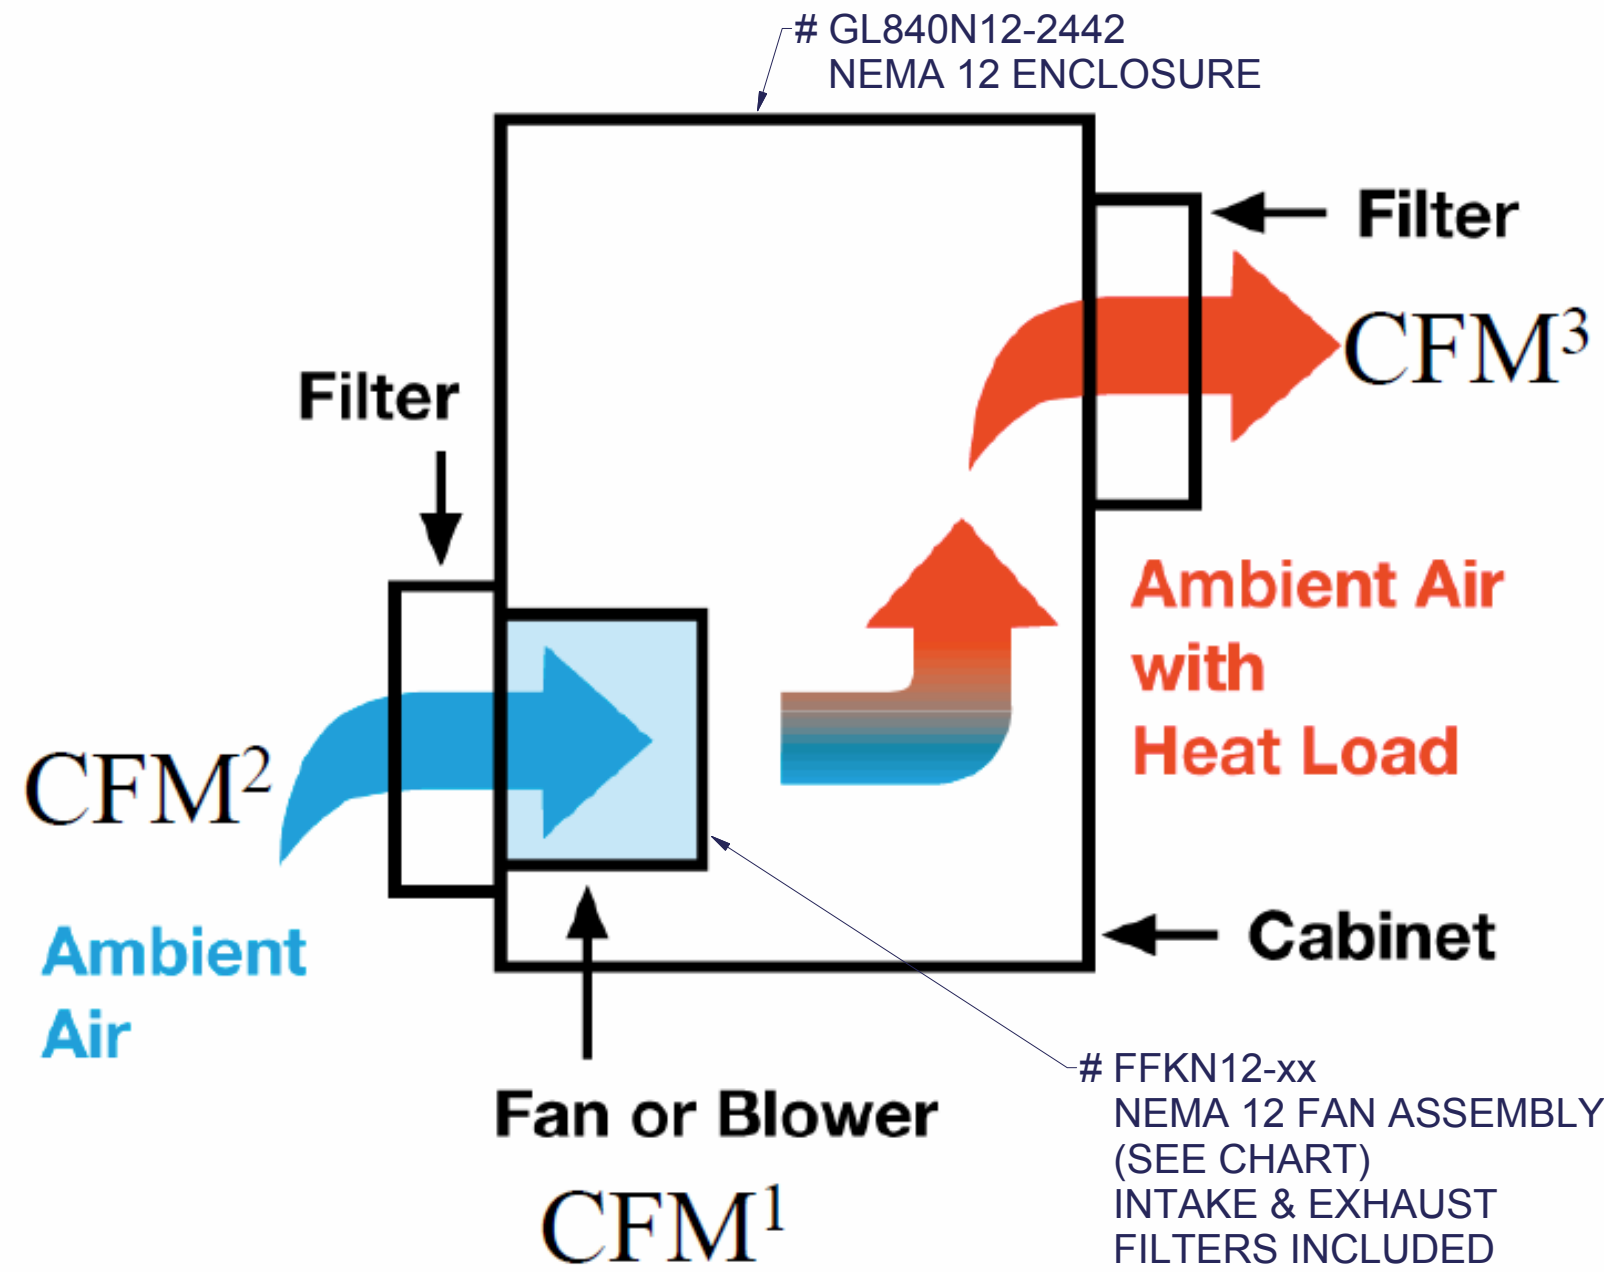

- CFM<sup>1</sup> - Fan only rating
- CFM<sup>2</sup> - Fan with filter & louvre rating (free flow)
- CFM<sup>3</sup> - System rating with exhaust (includes static pressure drop)

Model #	CFM <sup>1</sup>	CFM <sup>2</sup>	CFM <sup>3</sup>
FFKN12-A1	489	297	230
FFKN12-A2	1024	462	295
FFKN12-A3	1250	560	368

<small>INTERPRET DRAWING PER ASME Y14.5M-1994 DIMENSIONAL LIMITS APPLY AFTER APPLICATION OF FINISH DRAWING NOT TO SCALE TOLERANCE UNLESS OTHERWISE NOTED: ANGULAR +/- .1" .XXXX +/- .010 .XXX +/- .015 .XX +/- .030 .X FOR REF. ONLY</small>	<b>NOTICE:</b> Use of this document is subject to a confidentiality and nondisclosure agreement with Great Lakes Case & Cabinet Co., Inc. (GLCC) and may not be reproduced, disclosed or utilized in whole or in part without prior written authorization from GLCC.	<small>PART NUMBER:</small> FFKN12-xx	<small>TITLE</small> FFKN12-xx NEMA 12 FANS IN GL840N12-2442 ENCLOSURE
		<small>QTY PER UNIT:</small> 1	<small>GREAT LAKES CASE &amp; CABINET CO., INC.</small> P.O. BOX 551 EDINBORO, PA 16412 PHONE (814) 734-7303 FAX (814) 734-3907 E-MAIL glcc@greatcabinets.com
<small>UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES</small>	<small>THIRD ANGLE PROJECTION</small>	<small>DRAWN</small> JAL	<small>DATE</small> 3/24/2010
		<small>CHECKED &amp; APP.</small> -	<small>DATE</small> -
		<small>DWG NO.</small> FFKN12	<small>REV</small> 0
			<small>SHEET: 1 OF 1</small>